


DPM-MC2

Communication module

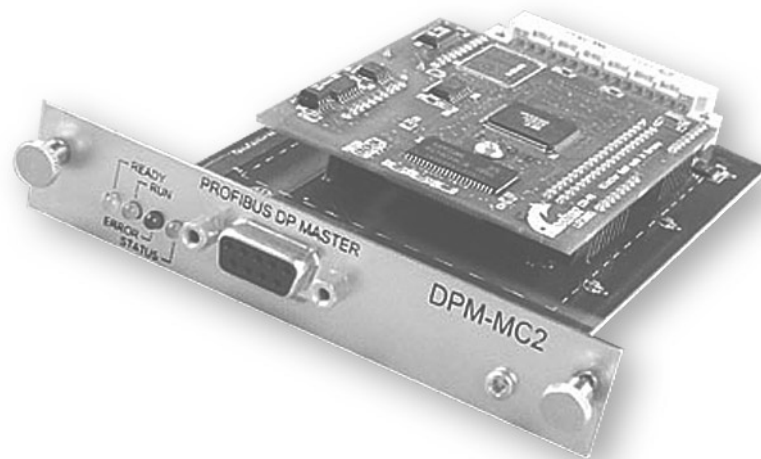

Imprint

Manufacturer

Eaton Automation AG
Spinnereistrasse 8-14
CH-9008 St. Gallen
Schweiz

www.eaton-automation.com
www.eaton.com

Support

Region North America

Eaton Corporation
Electrical Sector
1111 Superior Ave.
Cleveland, OH 44114
United States
877-ETN-CARE (877-386-2273)
www.eaton.com

Other regions

Please contact your supplier or send an E-Mail to:
automation@eaton.com

Original instructions

The German version of this document is the original instructions.

Editor

Peter Zuber

Brand and product names

All brand and product names are trademarks or registered trademarks of the owner concerned.

Copyright

© Eaton Automation AG, CH-9008 St. Gallen

All rights reserved, also for the translation.

None of this document may be reproduced or processed, duplicated or distributed by electronic systems in any form (print, photocopy, microfilm or any other process) without the written permission of Eaton Automation AG, St. Gallen.

Subject to modifications.

Proper use

Hardware, software, operating systems and drivers must only be used for the applications specified and only in conjunction with the components recommended by Eaton Automation AG.

Warning

No warranty claims will be recognised for faults arising from the improper handling of devices and modules.

The devices, even by means of communication, should not be used for the implementation of any safety functions relating to the protection of personnel and machinery.

No liability is accepted for claims for damages arising from a failure or functional defect in the device.

All data specified in this document does not represent warranted properties in the legal sense.

Contents

1	Introduction	5
1.1	Aim and purpose of this document	5
1.2	Use of the card	5
2	Function and Control LEDs	6
3	Connector assignment	7
4	Maintenance, repair, disposal	8
5	Technical data	9

1 INTRODUCTION

1.1 AIM AND PURPOSE OF THIS DOCUMENT

This documentation is designed as a reference for connecting, commissioning and operating the DPM-MC2 communication card.

1.2 USE OF THE CARD

This can only be used in MICRO PANEL MC2 series devices which are provided with an appropriate slot.

The DPM-MC2 card is a PROFIBUS master. This development is based on the EN50170 standard.

The card must only be fitted and removed when the device is in a de-energized state.

2 FUNCTION AND CONTROL LEDs

FRONT PANEL




READY (yellow)	Lit Flashing cyclically Flashing irregularly Dark	CIF ready Bootstraploader active Hardware or system error Hardware fault
RUN (green)	Lit Flashing cyclically Flashing irregularly Dark	Communication running Communication stopped Missing or faulty configuration No communication
ERROR (red)	Lit Dark	PROFIBUS error No error
STATUS (yellow)	Lit Dark	Sends data or token No token

3 CONNECTOR ASSIGNMENT


The plug connector and connector assignment comply with the Profibus standard (EN50170). Only the transceiver signals and the terminals with the power supply for line termination are provided.

Connector assignment

Pin no.	Signal	Description
1	nc	
2	nc	
3	RxD/TxD-P	Receive/Transmit-Data-P
4	CNTR-P	Control-P (Rep.Control)
5	DGND	Data Ground (Termination)
6	VP	Voltage-Plus (Termination)
7	nc	
8	RxD/TxD-N	Receive/Transmit-Data-N
9	nc	
Case	Shield	Cable shield

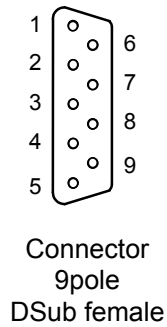

The power supply terminals DGND (0V, Pin 5) and VP (+5V, Pin 6) are only used for the power supply of the cable termination (Termination) and must not be used for anything else. The CNTR-P signal (Pin 4) is used in conjunction with a repeater.



**The bus segment must be terminated at both ends.
No more than 2 bus terminations must be activated for each bus segment!
At least one of the two bus terminations must be fed by the bus station!**

4 MAINTENANCE, REPAIR, DISPOSAL

Repairs

Repairs should only be carried out by the manufacturer or authorized repair centres. Please contact in this case your local MICRO PANEL dealer or the Technical Support at Eaton Automation. The warranty is not applicable if any modifications are made to the device that are not described in this document.

Transport

Only the original packaging must be used for transporting the device.

Disposal

Cards that are no longer used, must be properly disposed of or returned to the manufacturer or sales for their proper disposal.

5 TECHNICAL DATA

Profibus	Type Connection	Profibus, isolated Sub-D 9 pole female
Ambient conditions 1)	Operating climate Storage climate Vibration Shock: Fall test:	0...50°C, 10...95% rel. air humidity, non- condensing -20...60°C, 10...95% rel. air humidity, non- condensing IEC68-2-6 IEC68-2-27 IEC68-2-32
EMC (CE)1)		EN 61000-6-2, EN 610006-4 EN 61131-2
Safety 1)		EN 60950 UL 60950 (UL)
Product standards 1)		EN 50178, Electrical equipment for use in electrical installations EN61131-2, PLCs

1) This information refers to the entire Micro Panel.